

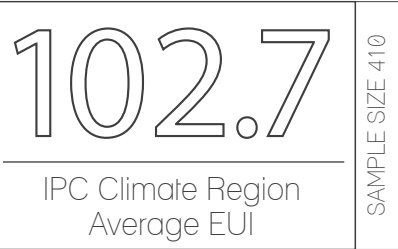


CBECS: OFFICE

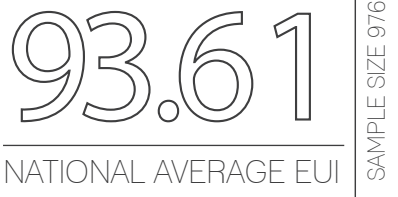

- miscellaneous
- computer
- office equipment
- refrigeration
- cooking
- lighting
- water heating
- ventilation
- cooling
- heating

IPCCR Disaggregated EUI

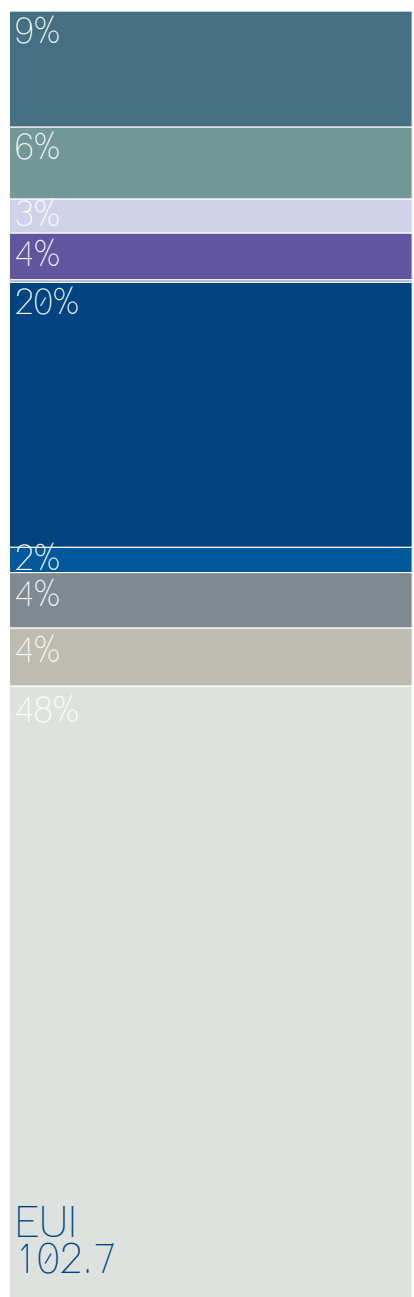

The CBECS classifies buildings according to their "principal building activity (PBA)" at the time when the survey is completed. The PBA is defined as the primary business, commerce, or function within each building. For projects with multiple activity classifications, the activity that occupies the most floorspace ultimately defines the usage type category. Buildings are also classified into more specific sub-categories of activities, which are reflected in the "National Office Activity Breakdown" chart below.


The CBECS website specifically defines the office principal building activity as "Buildings used for general office space, professional office, or administrative offices. Medical offices are included here if they do not use any type of diagnostic medical equipment (if they do, they are categorized as an outpatient health care building)."

More information on building activity definitions can be found on the CBECS website located here:

http://www.eia.gov/emeu/cbeecs/building_types.html#Office


IPCCR % of Buildings with Renovations

SAMPLE SIZE 410

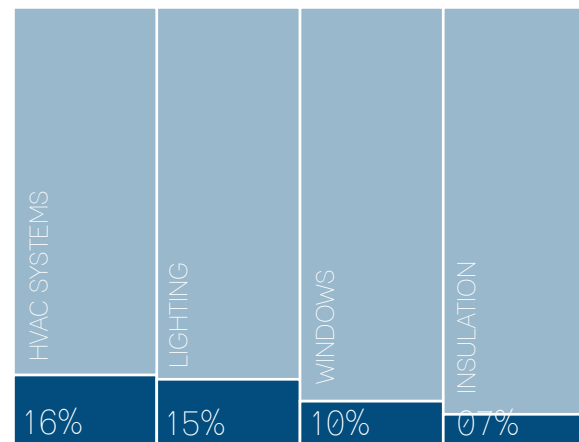


National Office Activity Breakdown

SAMPLE SIZE 976

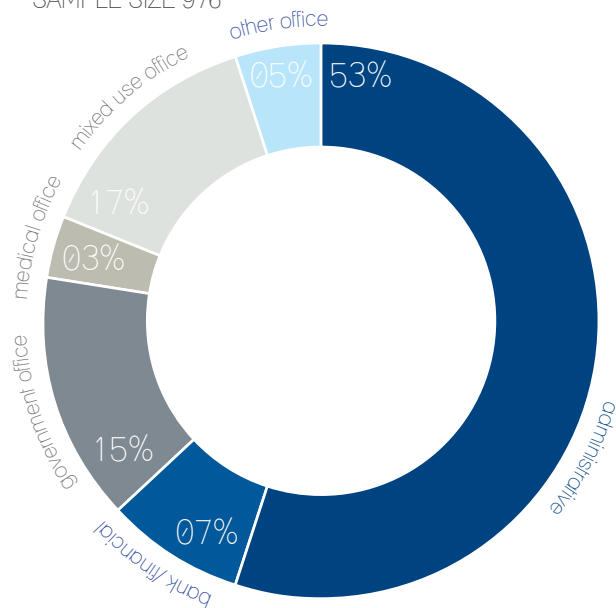

IPCCR Utility Breakdown


SAMPLE SIZE 263

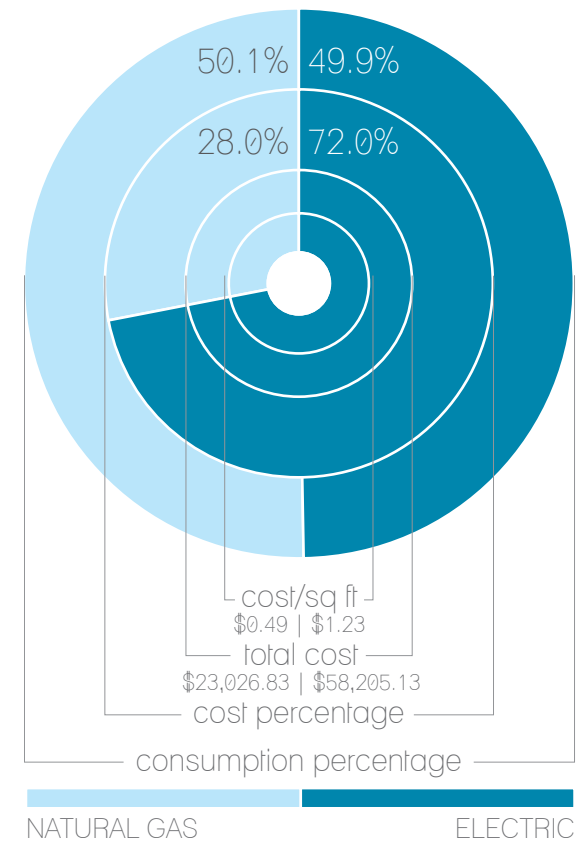

created by:




sponsored by:

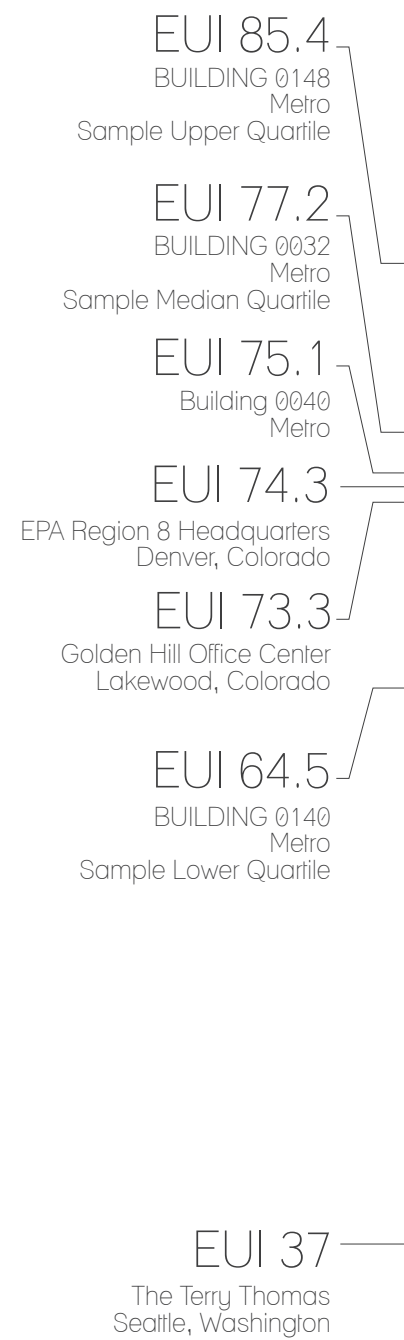


IPCCR EUI by HVAC Characteristics

SAMPLE SIZE 382

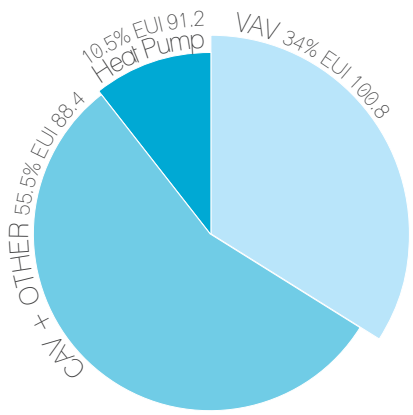


BUILDINGS WITH EMS

SAMPLE SIZE 382

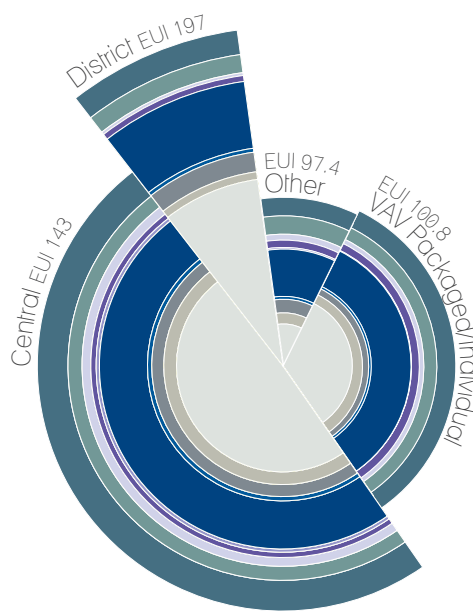


VAV CHARACTERISTICS

SAMPLE SIZE 130

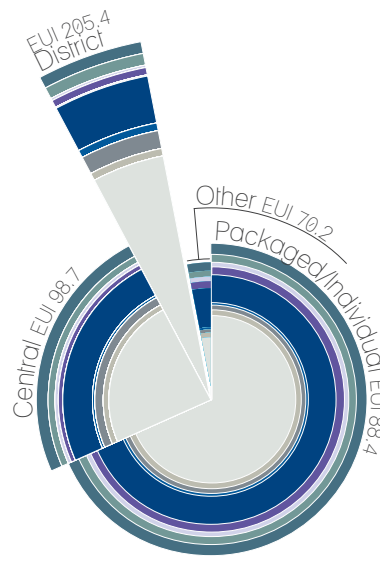

CAV + OTHER CHARACTERISTICS

SAMPLE SIZE 212

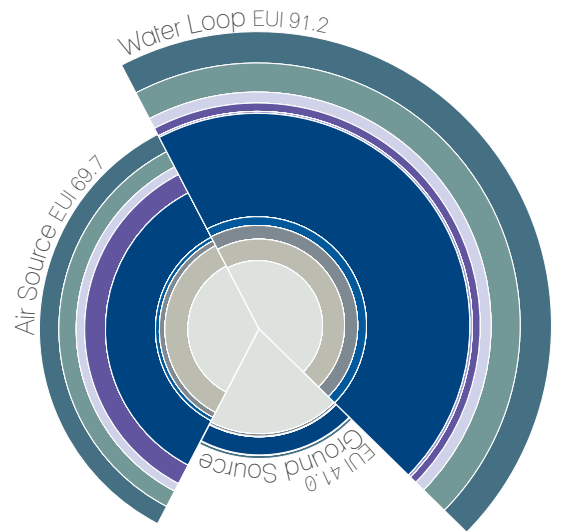




HEAT PUMP CHARACTERISTICS

SAMPLE SIZE 40

- miscellaneous
- computer
- office equipment
- refrigeration
- cooking
- lighting
- water heating
- ventillation
- cooling
- heating

IPCCR EUI by Building Shape

SAMPLE SIZE 360

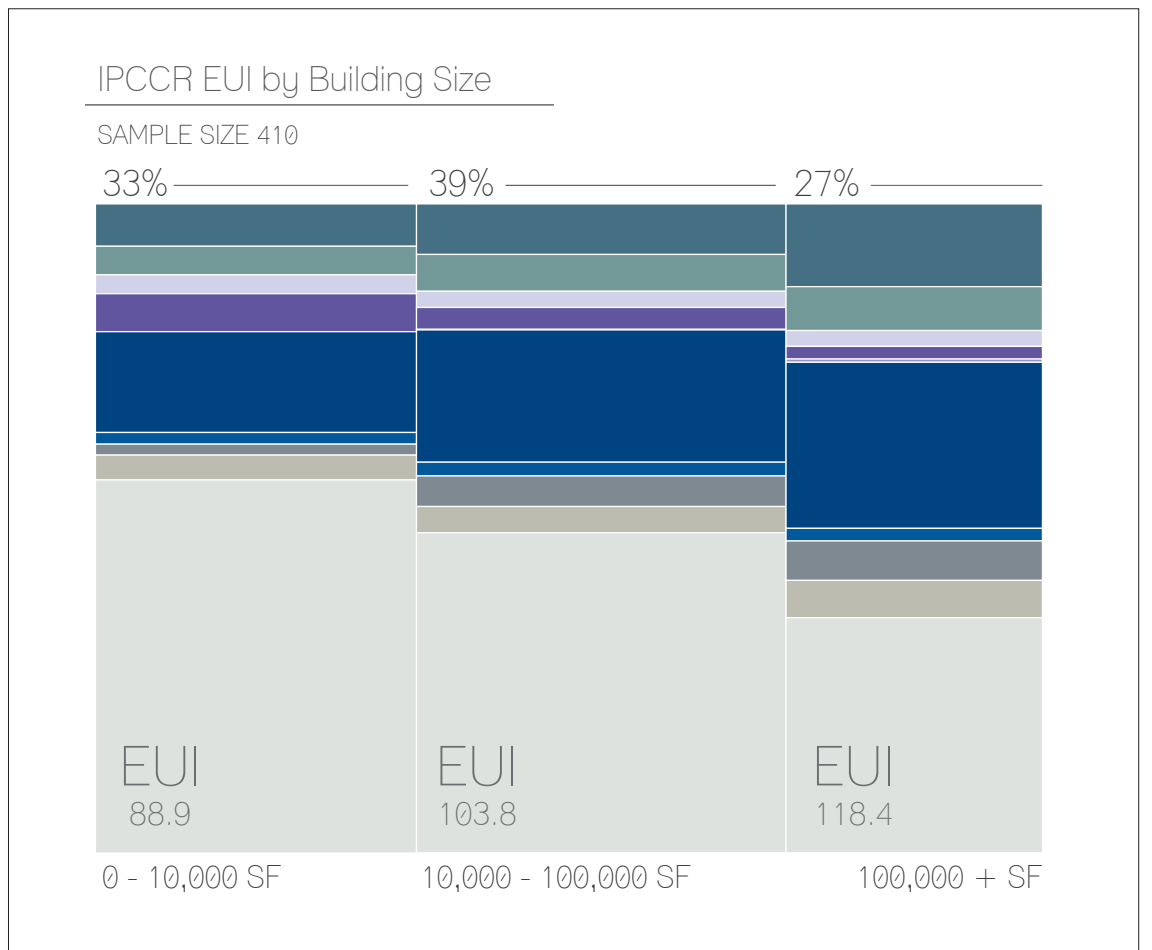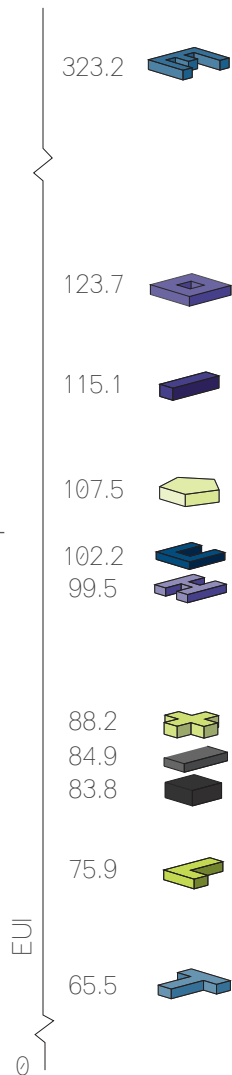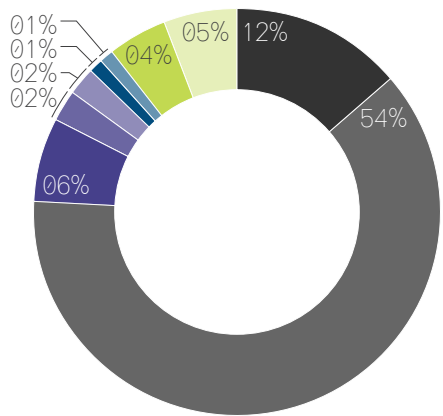

IPCCR EUI By Vintage / End Use

SAMPLE SIZE 401

